
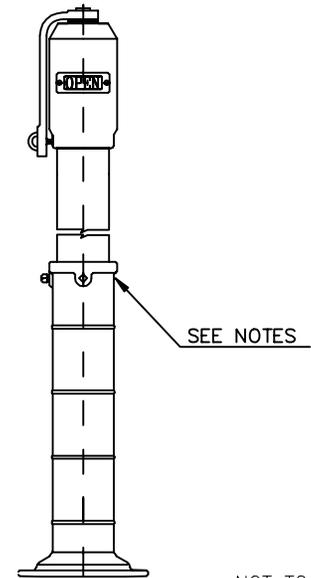


NOTES

INDICATOR POST SHALL BE AFC IP-71 OR KENNEDY 2945 OR EQUAL. APPROVED IN ADVANCE BY CITY OF KINGMAN FIRE DEPT. AND INSTALLED PER MANUFACTURES SPEC.  
 ALL JOINTS SHALL BE MEGA-LUG RESTRAINED OR APPROVED EQUAL.

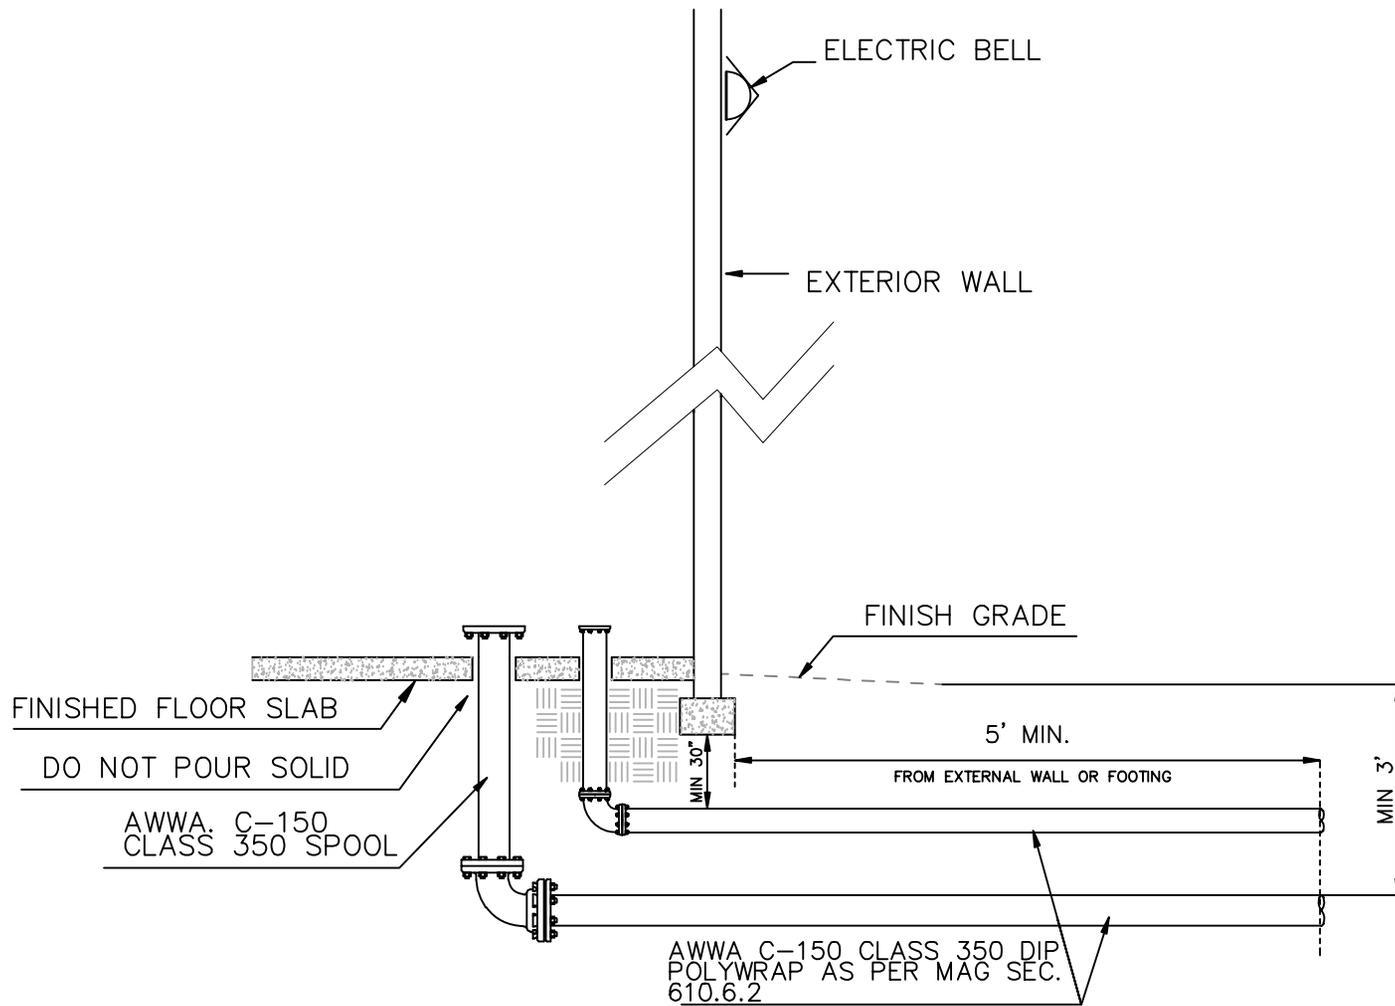

NOT TO SCALE

DETAIL NO.  
364

STANDARD DETAIL

UNDERGROUND STUB UP DETAIL WITH REMOTE FIRE DEPT CONNECTION

CITY OF KINGMAN

DETAIL NO.  
364